



Notes:

1. The water main shall be installed on the north or east side of the street, 4 ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe.
2. The wastewater main shall be installed in the middle of the drive lane depicted above, with a maximum cover of 20 ft over the pipe.
3. Gas and electric mains are usually installed in a joint trench behind the curb. When the gas pressure is greater than 60 psi the gas line is installed 10 ft from the edge of the storm sewer main at a depth of 4 ft.
4. The storm sewer shall be installed with 2 ft of clearance from the outside edge of the gutter pan and 3 ft of cover over the pipe on the opposite side of the street from the water main.
5. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.

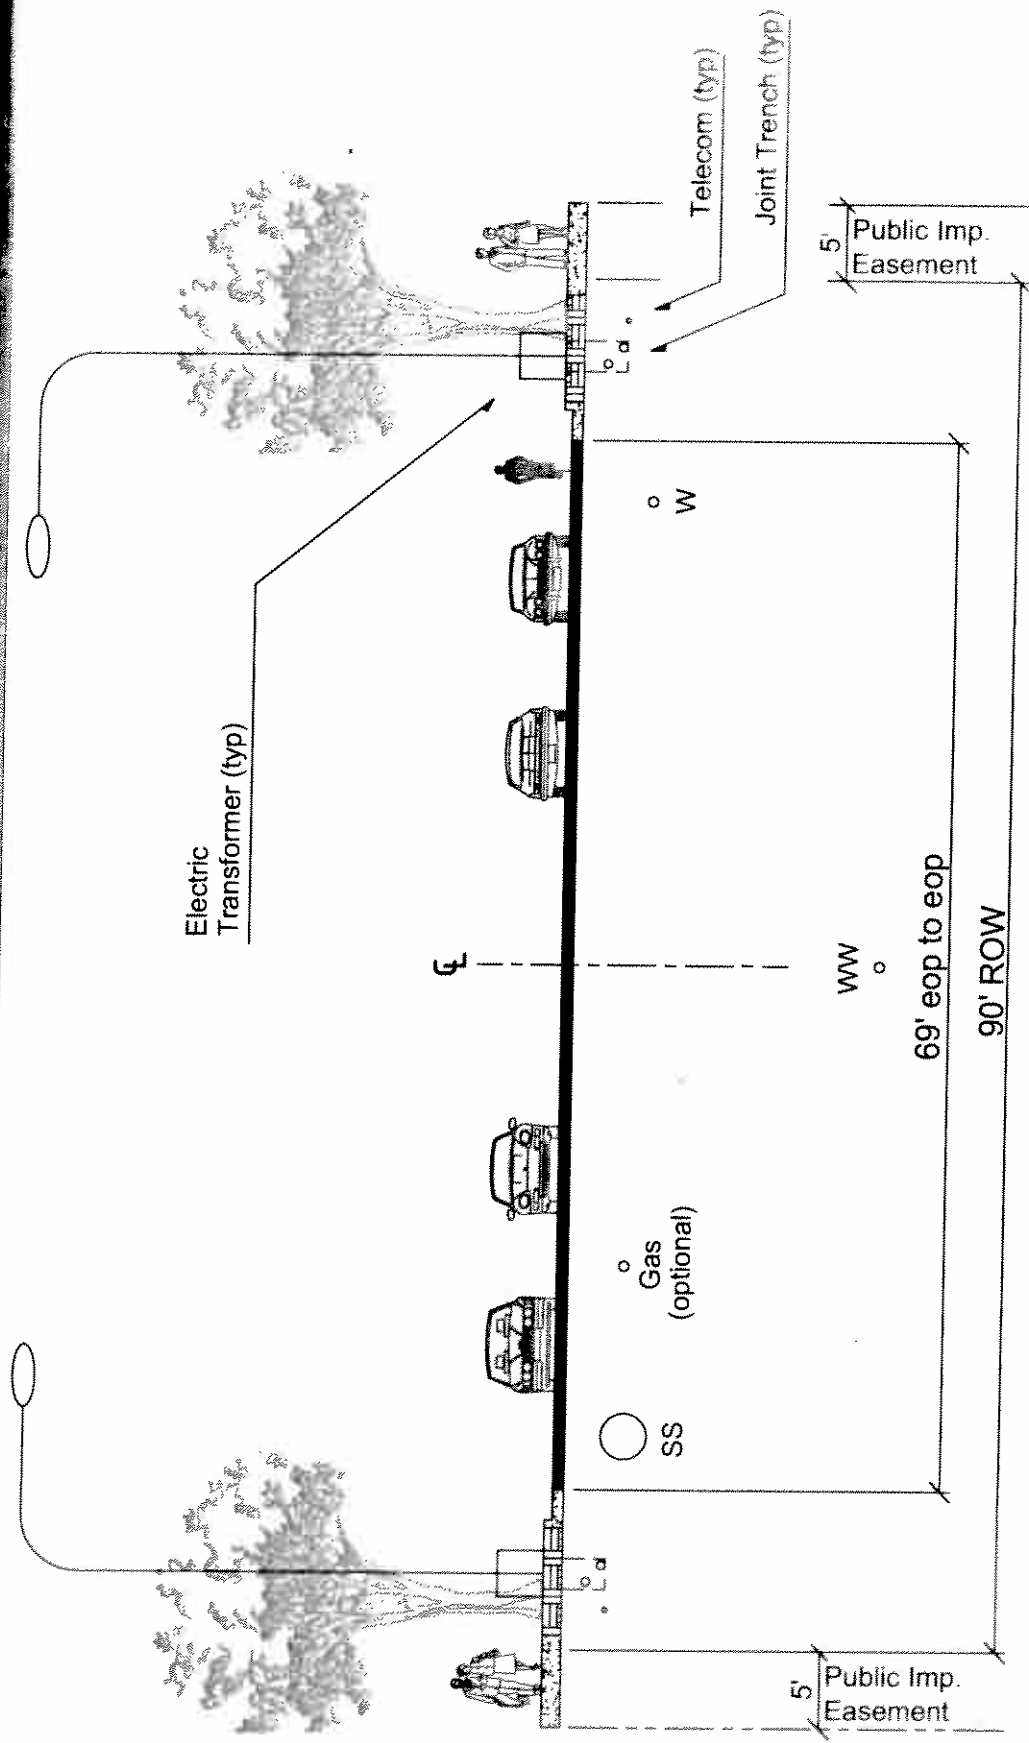


Notes:

1. The water main shall be installed on the north or east side of the street, 4 ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe.
2. The wastewater main shall be installed in the center of pavement as depicted above, with a maximum cover of 20 ft over the pipe.
3. Gas and electric mains are usually installed in a joint trench behind the curb. When the gas pressure is greater than 60 psi the gas line is installed 10ft from the edge of the storm sewer main at a depth of 4 ft.
4. The storm sewer shall be a maximum diameter of 36 in, installed with 2 ft of clearance from the outside edge of the gutter pan and 3 ft of cover over the pipe on the opposite side of the street from the water main.
5. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.

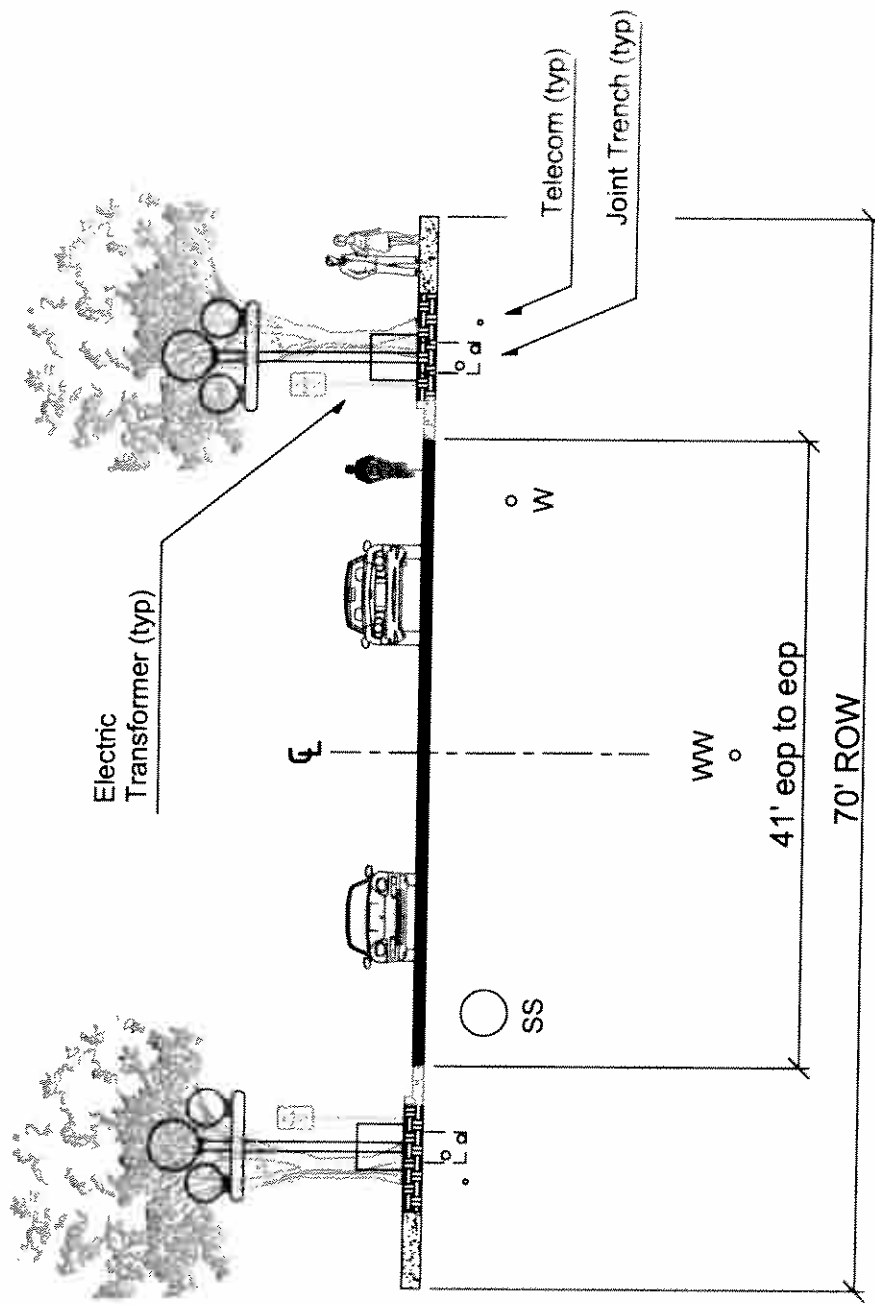


Notes:

1. The water main shall be installed on the north or east side of the street, 4 ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe. Maximum size of water main allowed is 8 in.
2. The wastewater main shall be installed in the center of pavement as depicted above, with a maximum cover of 20 ft over the pipe.
3. Gas and electric mains are usually installed in a joint trench behind the curb. When the gas pressure is greater than 60 psi the gas line is installed 10 ft from the edge of the storm sewer main at a depth of 4 ft.
4. It is likely that this street corridor will have a 600A electric circuit installed within it. If a 600A electric circuit is required then it will be installed in lieu of one of the joint trench installations.
5. The storm sewer shall be a maximum diameter of 36 in, installed with 2 ft of clearance from the outside edge of the gutter pan and 3 ft of cover over the pipe on the opposite side of the street from the water main.
6. The storm sewer shall be constructed of thermoplastic material in order to be within the wastewater excavation trench.
7. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.

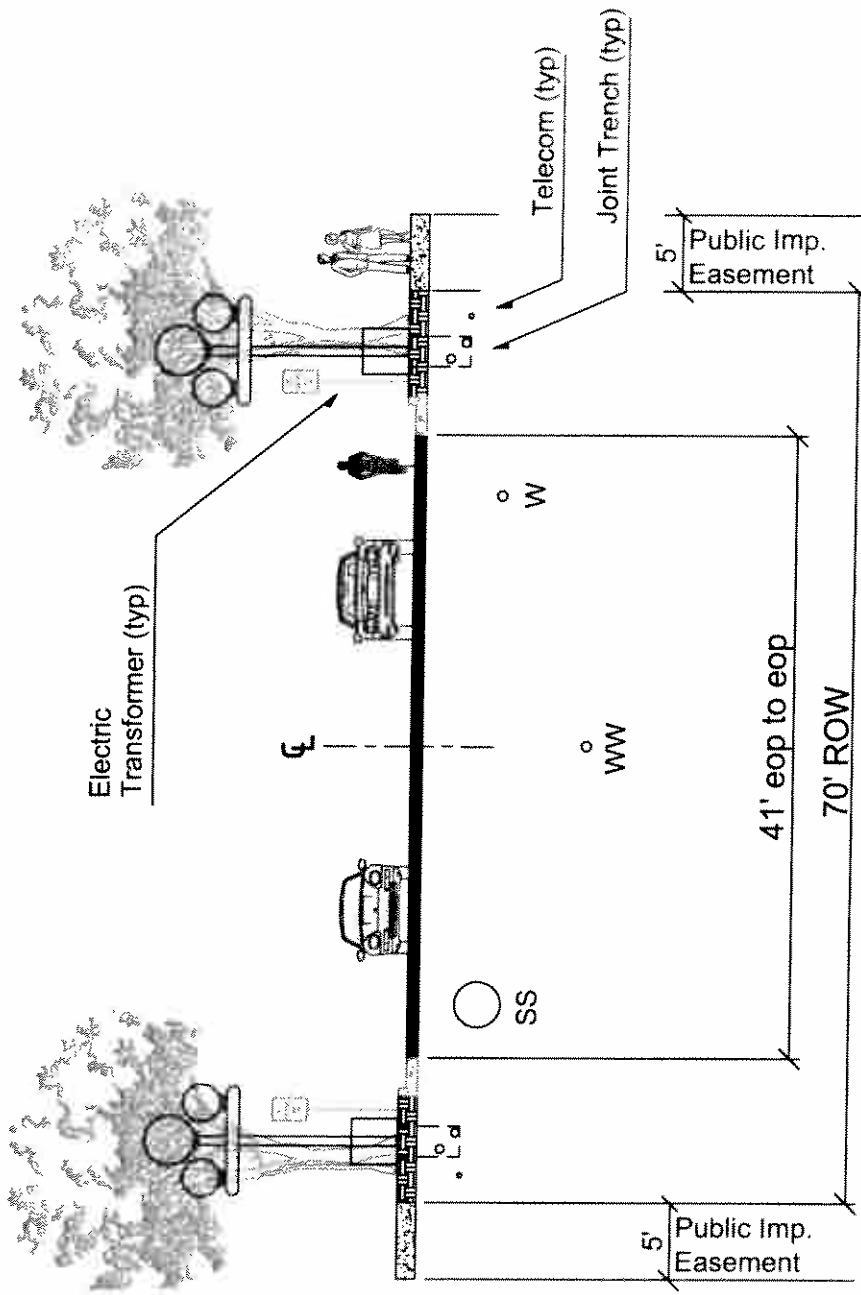


Notes:

1. The water main shall be installed on the north or east side of the street, 4 ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe.
2. The wastewater main shall be installed in the center of pavement as depicted above, with a maximum cover of 11 ft over the pipe.
3. The storm sewer shall be a maximum diameter of 36 in, installed with 2 ft of clearance from the outside edge of the gutter pan and 3 ft of cover over the pipe on the opposite side of the street from the water main.
4. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.
5. It is likely that this street corridor will have a 600A electric circuit installed within it. If a 600A electric circuit is required then it will be installed in lieu of one of the joint trench installations.

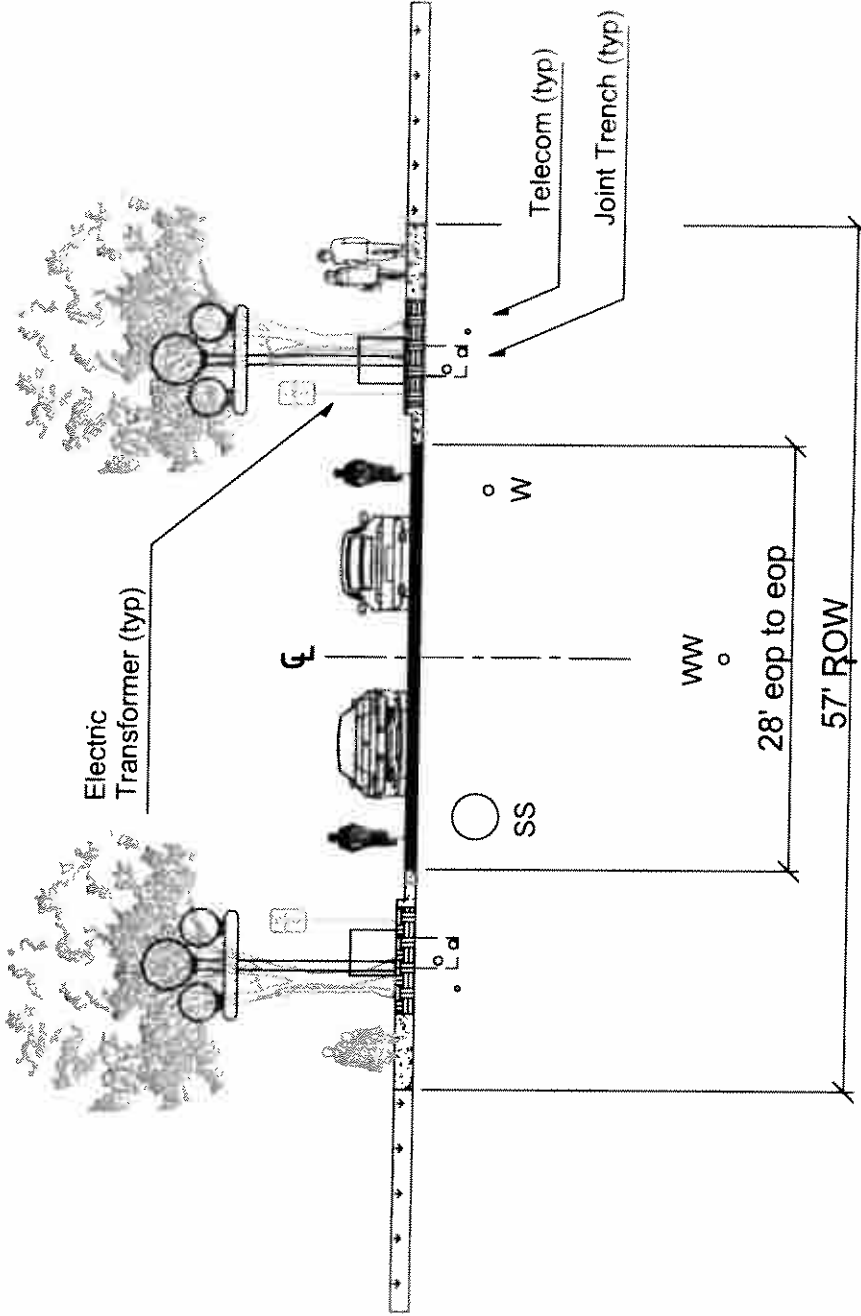


Notes:

1. The water main shall be installed on the north or east side of the street, 3 ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe. Water main shall be constructed of PVC or HDPE. Maximum size of water main allowed is 8 in.
2. The wastewater main shall be installed in the center of pavement as depicted above, with a maximum cover of 20 ft over the pipe.
3. The storm sewer shall be a maximum diameter of 36 in, installed with 2 ft of clearance from the outside edge of the gutter pan and 3 ft of cover over the pipe on the opposite side of the street from the water main.
4. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.
5. The storm sewer shall be constructed of thermoplastic material in order to be within the wastewater excavation trench.

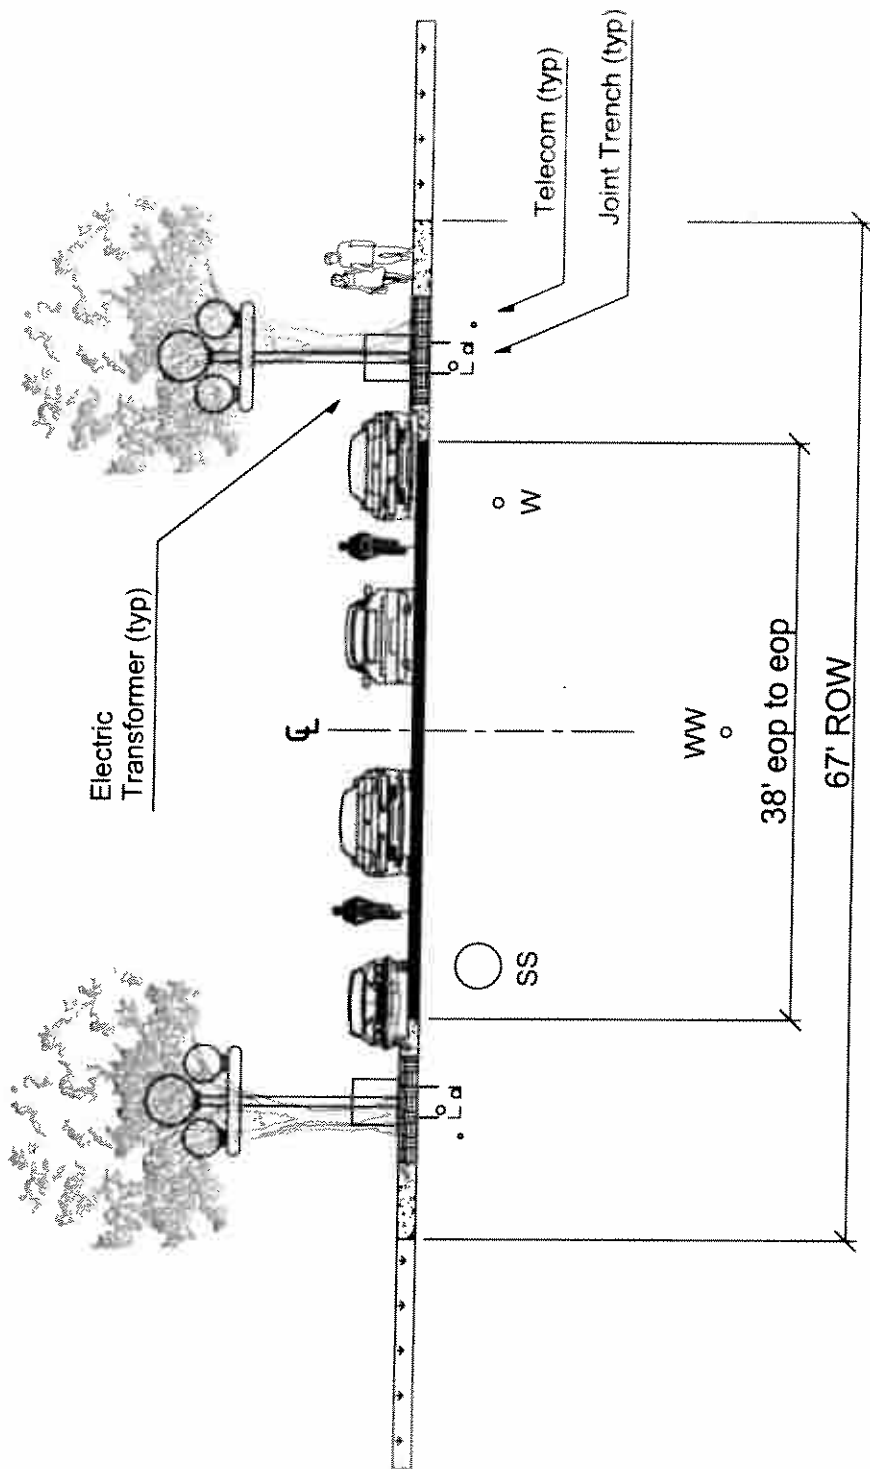


Notes:

1. The water main shall be installed on the north or east side of the street, 4 ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe.
2. The wastewater main shall be installed in the center of pavement as depicted above, with a maximum cover of 20 ft over the pipe.
3. The storm sewer shall be a maximum diameter of 36 in., installed with 2 ft of clearance from the outside edge of the gutter pan and 3 ft of cover over the pipe on the opposite side of the street from the water main.
4. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.
5. The storm sewer shall be constructed of thermoplastic material in order to be within the wastewater excavation trench.

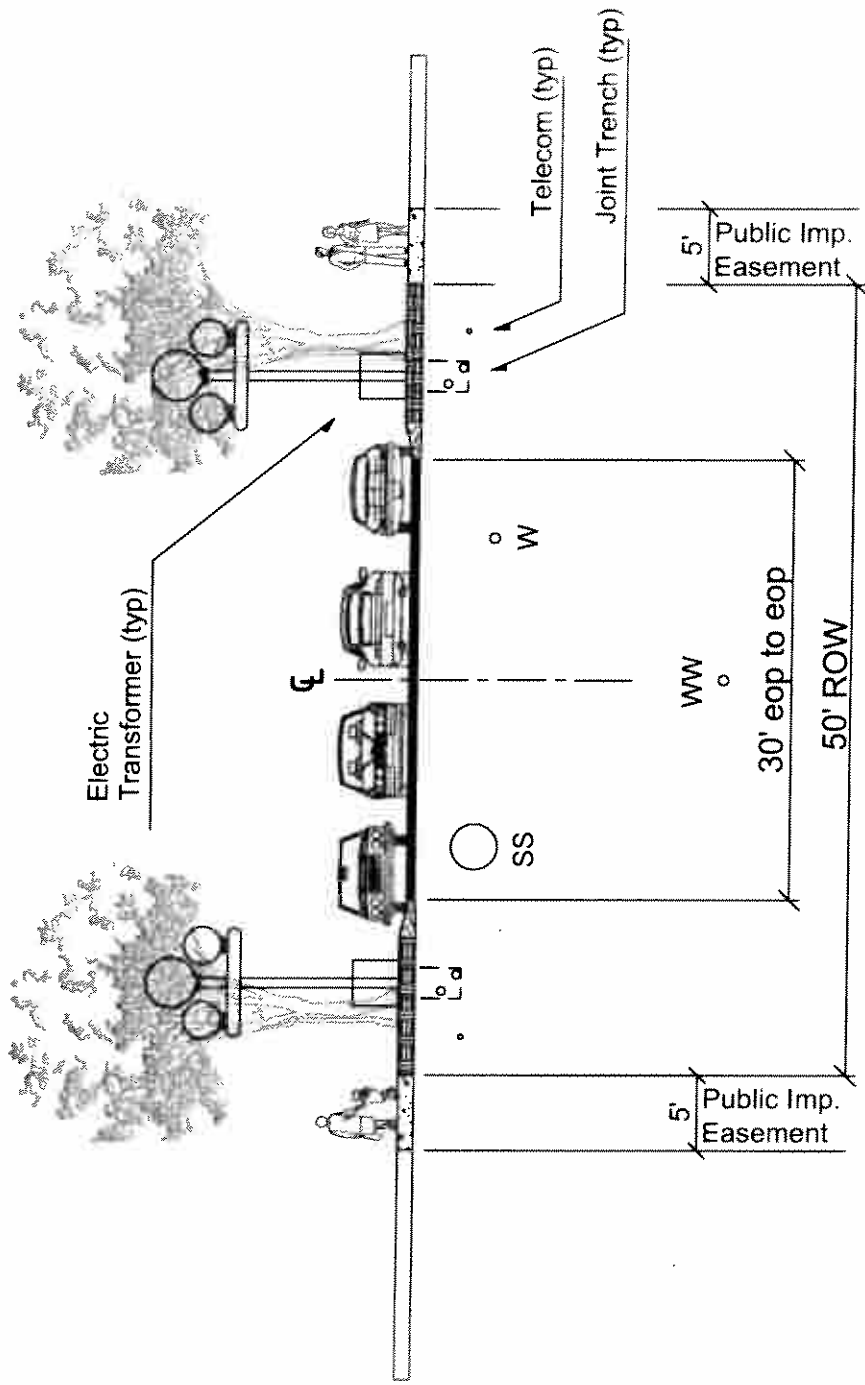


Notes:

1. The water main shall be installed on the north or east side of the street, 4ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe.
2. The wastewater main shall be installed in the center of pavement as depicted above, with a maximum cover of 20 ft over the pipe.
3. The storm sewer shall be a maximum diameter of 36 in, installed with 2 ft of clearance from the outside edge of the gutter pan and 3 ft of cover over the pipe on the opposite side of the street from the water main.
4. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.
5. The storm sewer shall be constructed of thermoplastic material in order to be within the wastewater excavation trench.

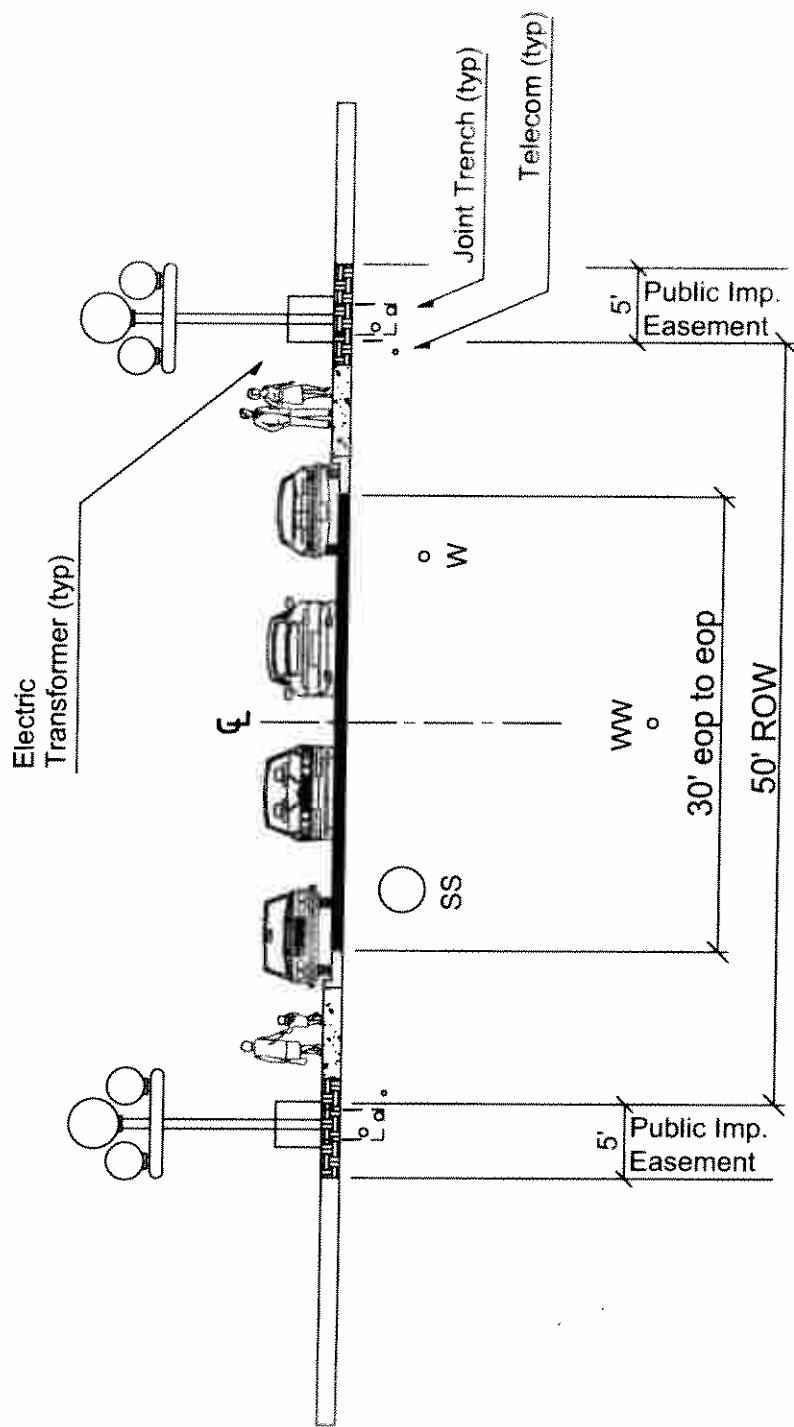


Notes:

1. The water main shall be installed on the north or east side of the street, 4 ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe.
2. The wastewater main shall be installed in the center of pavement as depicted above, with a maximum cover of 20 ft over the pipe.
3. The storm sewer shall be a maximum diameter of 36 in, installed with 2 ft of clearance from the outside edge of the gutter pan and 3 ft of cover over the pipe on the opposite side of the street from the water main.
4. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.
5. The storm sewer shall be constructed of thermoplastic material in order to be within the wastewater excavation trench.

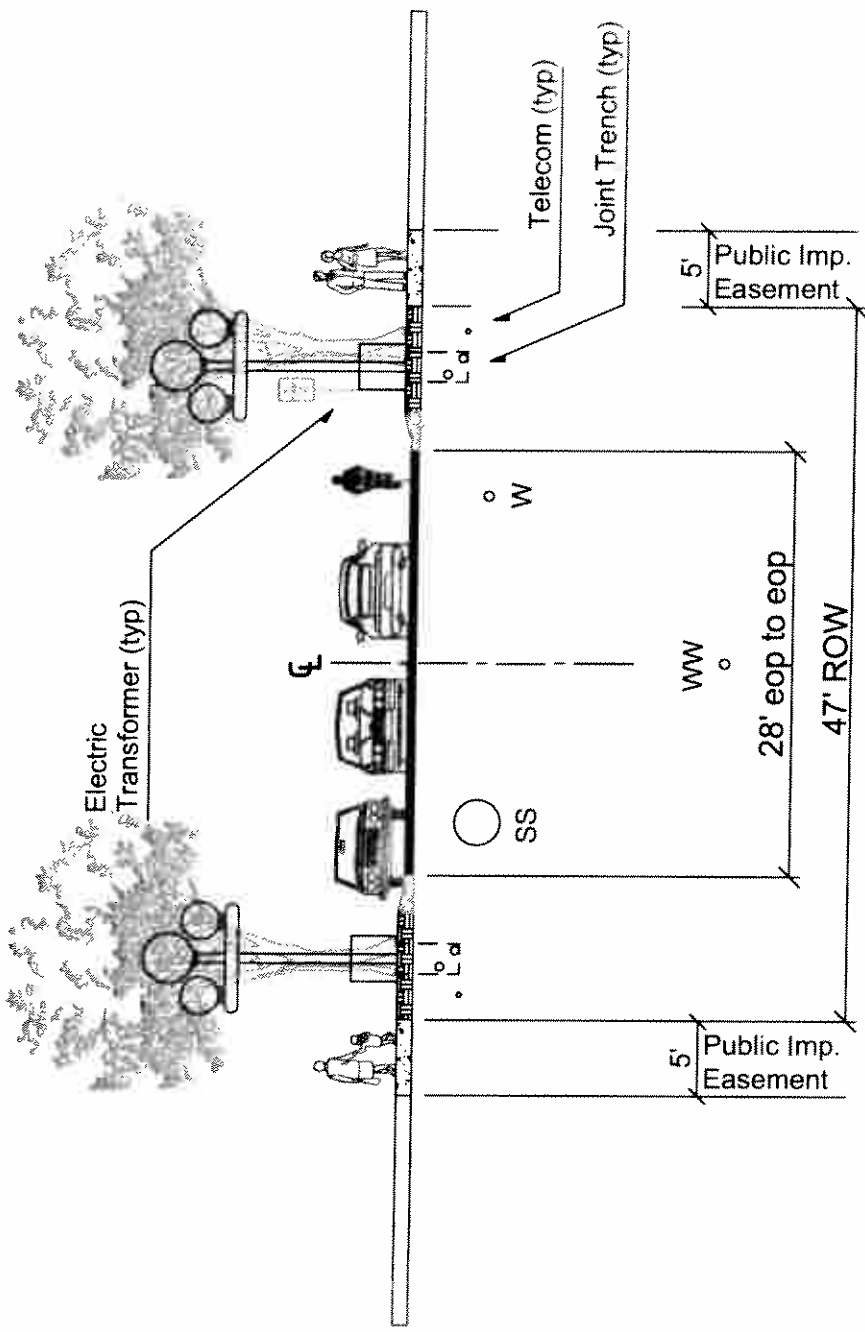


Notes:

1. The water main shall be installed on the north or east side of the street, 3 ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe. Water main shall be constructed of PVC or HDPE. Maximum size of water main allowed is 8 in.
2. The wastewater main shall be installed in the center of pavement as depicted above, with a maximum cover of 20 ft over the pipe.
3. The storm sewer shall be a maximum diameter of 36 in, installed with 2 ft of clearance from the outside edge of the gutter pan and 3 ft of cover over the pipe on the opposite side of the street from the water main.
4. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.
5. The storm sewer shall be constructed of thermoplastic material in order to be within the wastewater excavation trench.

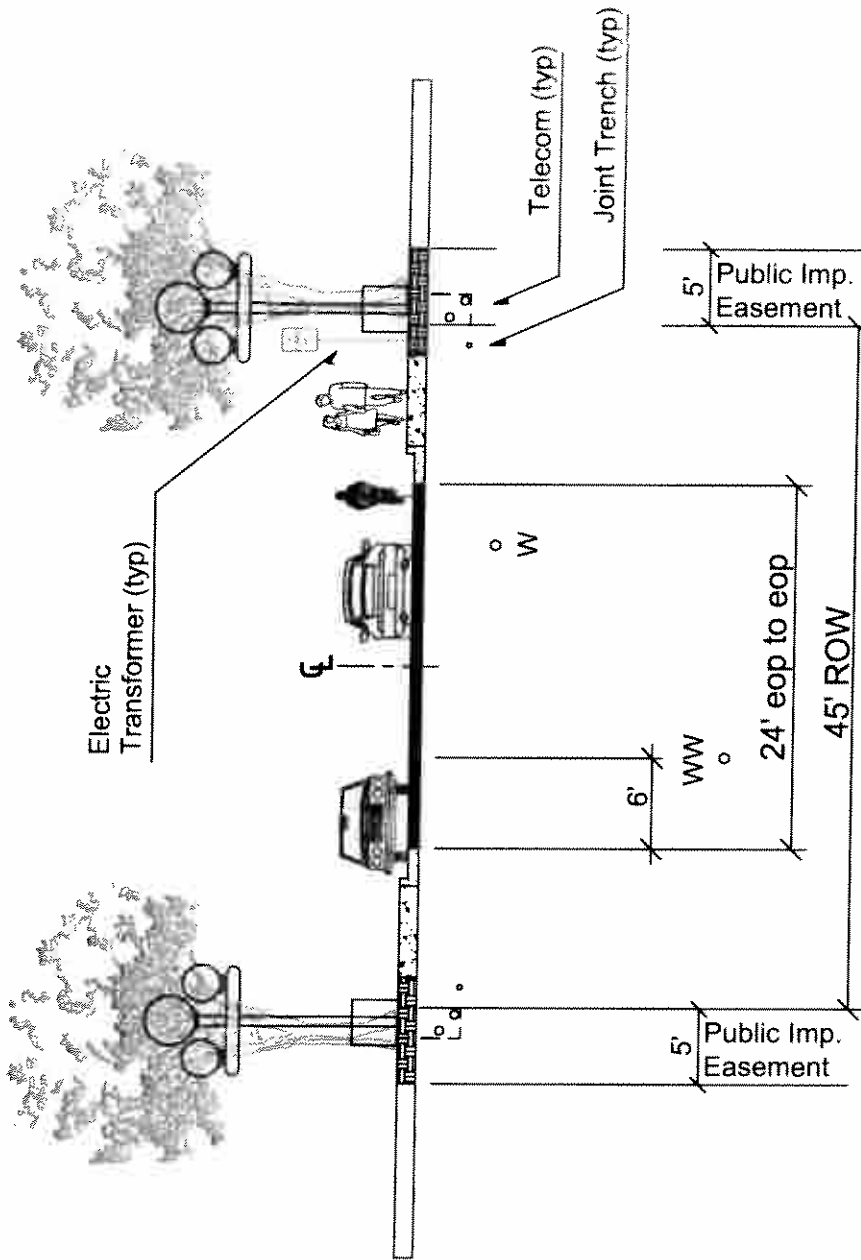


Notes:

1. The water main shall be installed on the north or east side of the street, 4 ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe.
2. The wastewater main shall be installed in the center of the drive lane as depicted above, with a maximum cover of 20 ft over the pipe.
3. The storm sewer can only be allowed after consulting with City Engineering and Colorado Springs Utilities.
4. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.

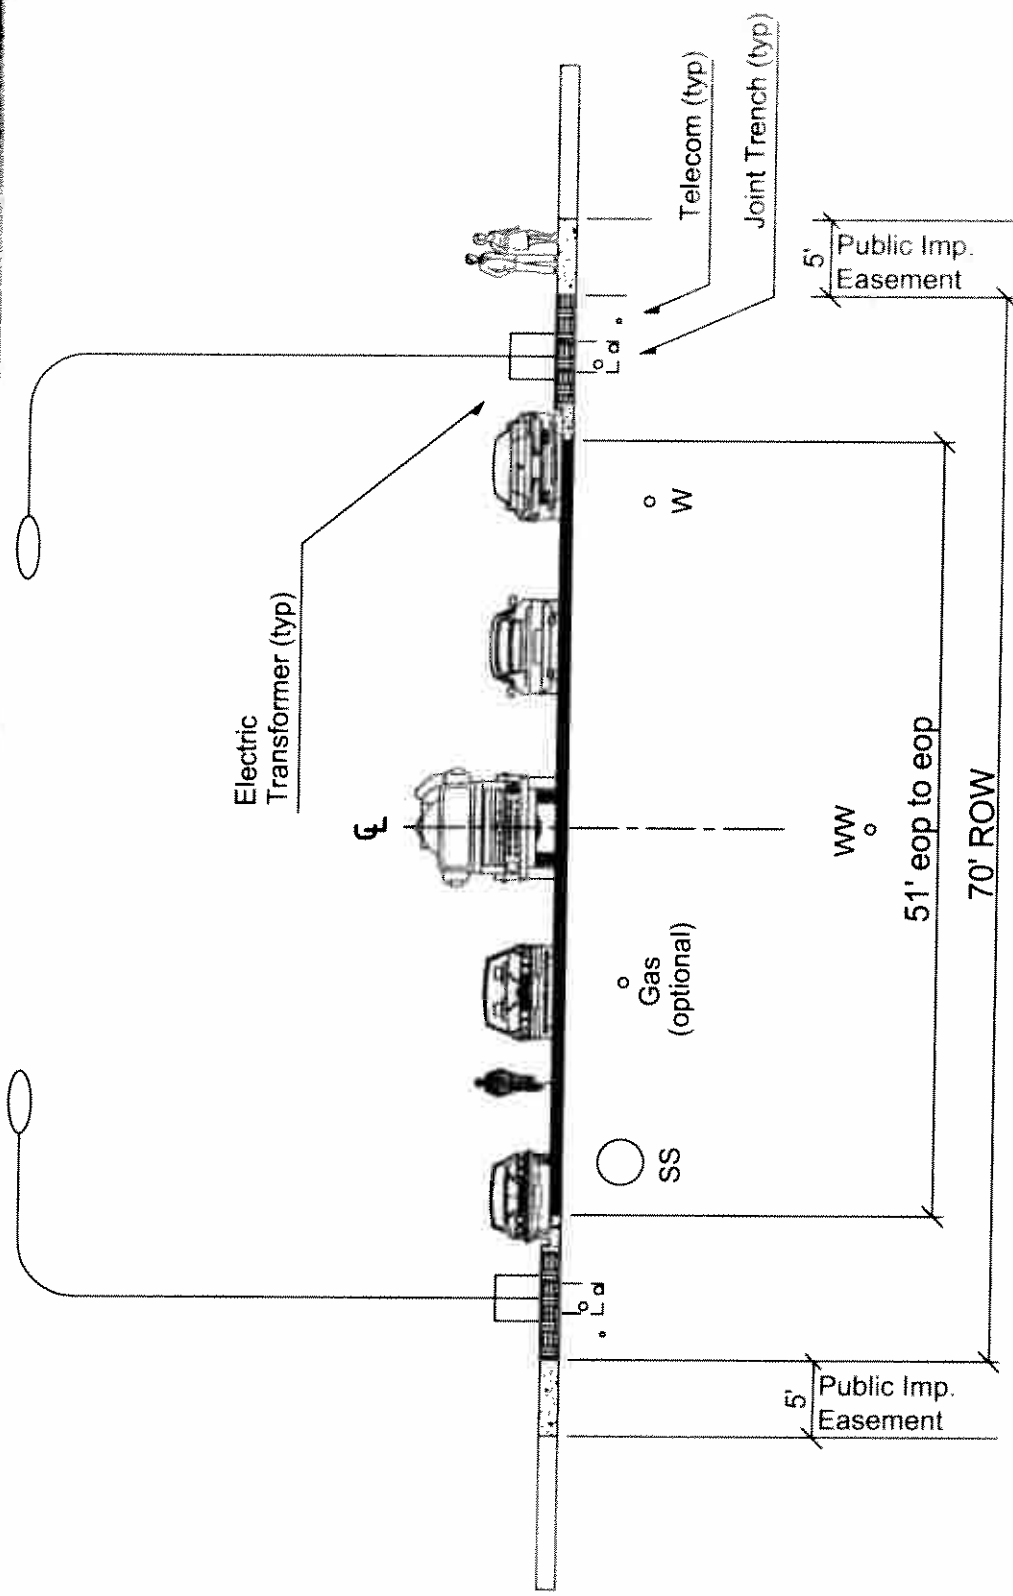

Notes:

1. The water main shall be installed on the north or east side of the street, 4 ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe.
2. The wastewater main shall be installed in the center of pavement as depicted above, with a maximum cover of 20 ft over the pipe.
3. Gas and electric mains are usually installed in a joint trench behind the curb. When the gas pressure is greater than 60 psi the gas line is installed 10 ft from the edge of the storm sewer main at a depth of 4 ft.
4. The storm sewer shall be a maximum diameter of 36 in, installed with 2 ft of clearance from the outside edge of the gutter pan and 3 ft of cover over the pipe on the opposite side of the street from the water main.
5. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.
6. The storm sewer shall be constructed of thermoplastic material in order to be within the wastewater excavation trench.

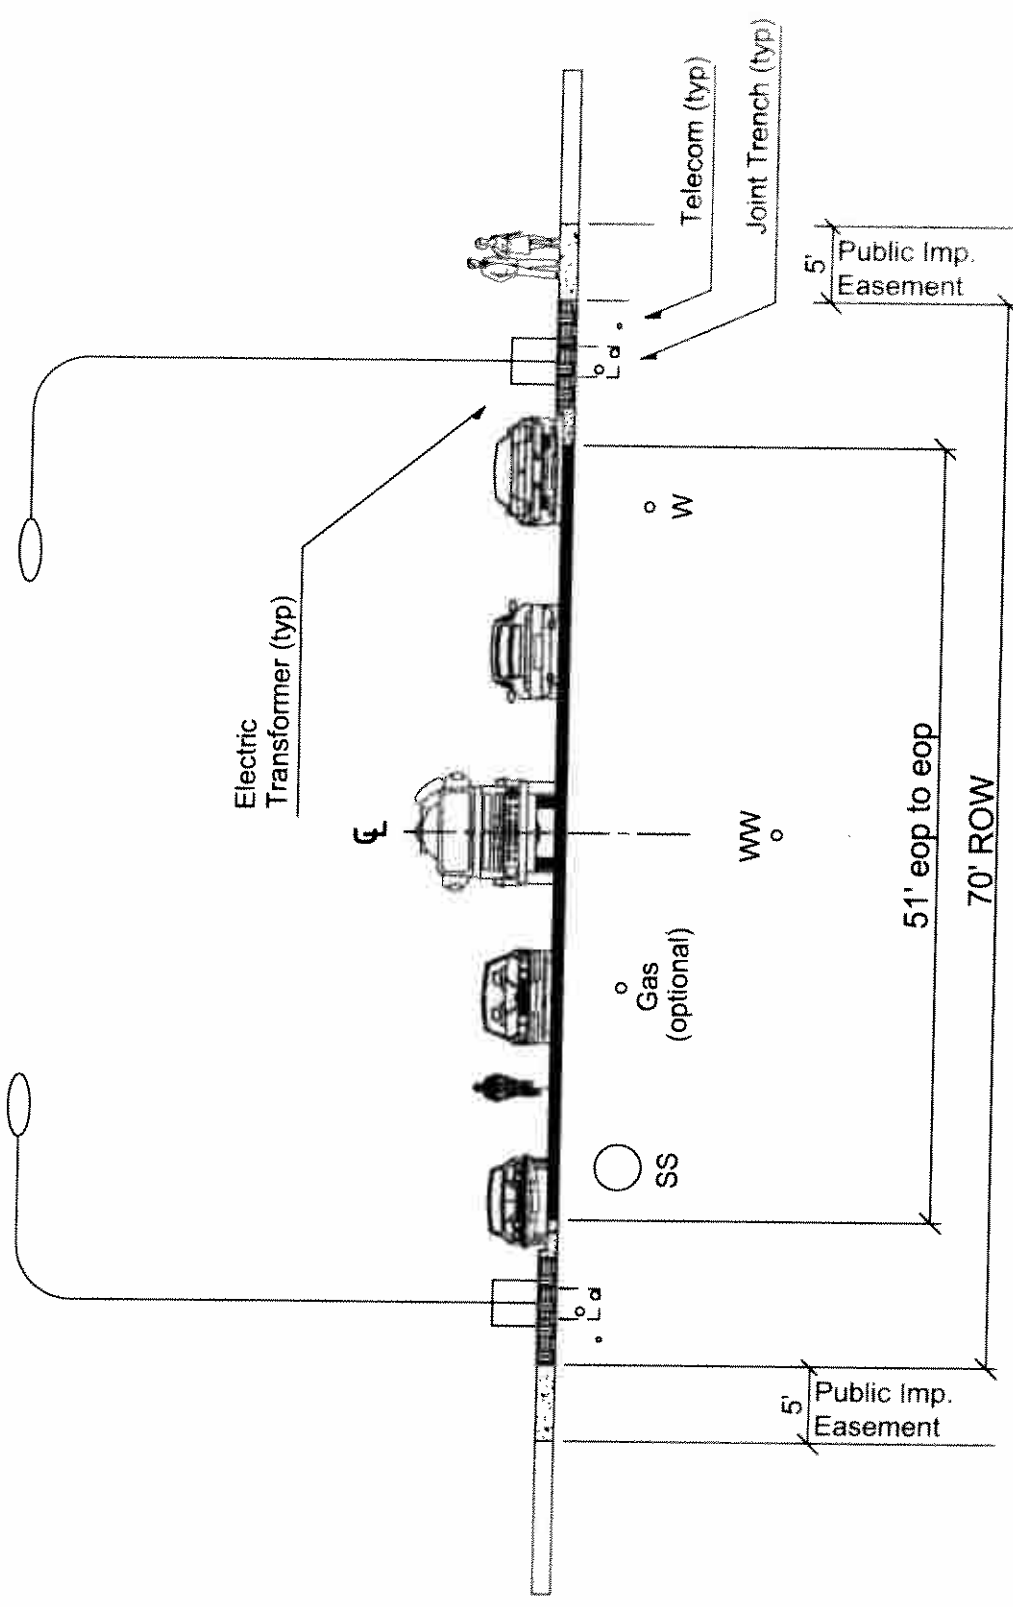

Notes:

1. The water main shall be installed on the north or east side of the street, 4 ft from the edge of pavement with 5 ft to 6 ft of cover over the pipe.
2. The wastewater main shall be installed in the center of pavement as depicted above, with a maximum cover of 14 ft over the pipe.
3. Gas and electric mains are usually installed in a joint trench behind the curb. When the gas pressure is greater than 60 psi the gas line is installed 10 ft from the edge of the storm sewer main at a depth of 4 ft.
4. The storm sewer shall be a maximum diameter of 36 in, installed with 2 ft of clearance from the outside edge of the gutter pan and 3 ft of cover over the pipe on the opposite side of the street from the water main.
5. Telecommunication lines may be installed in the 7 ft tree lawn, 1 ft from the edge of the sidewalk.